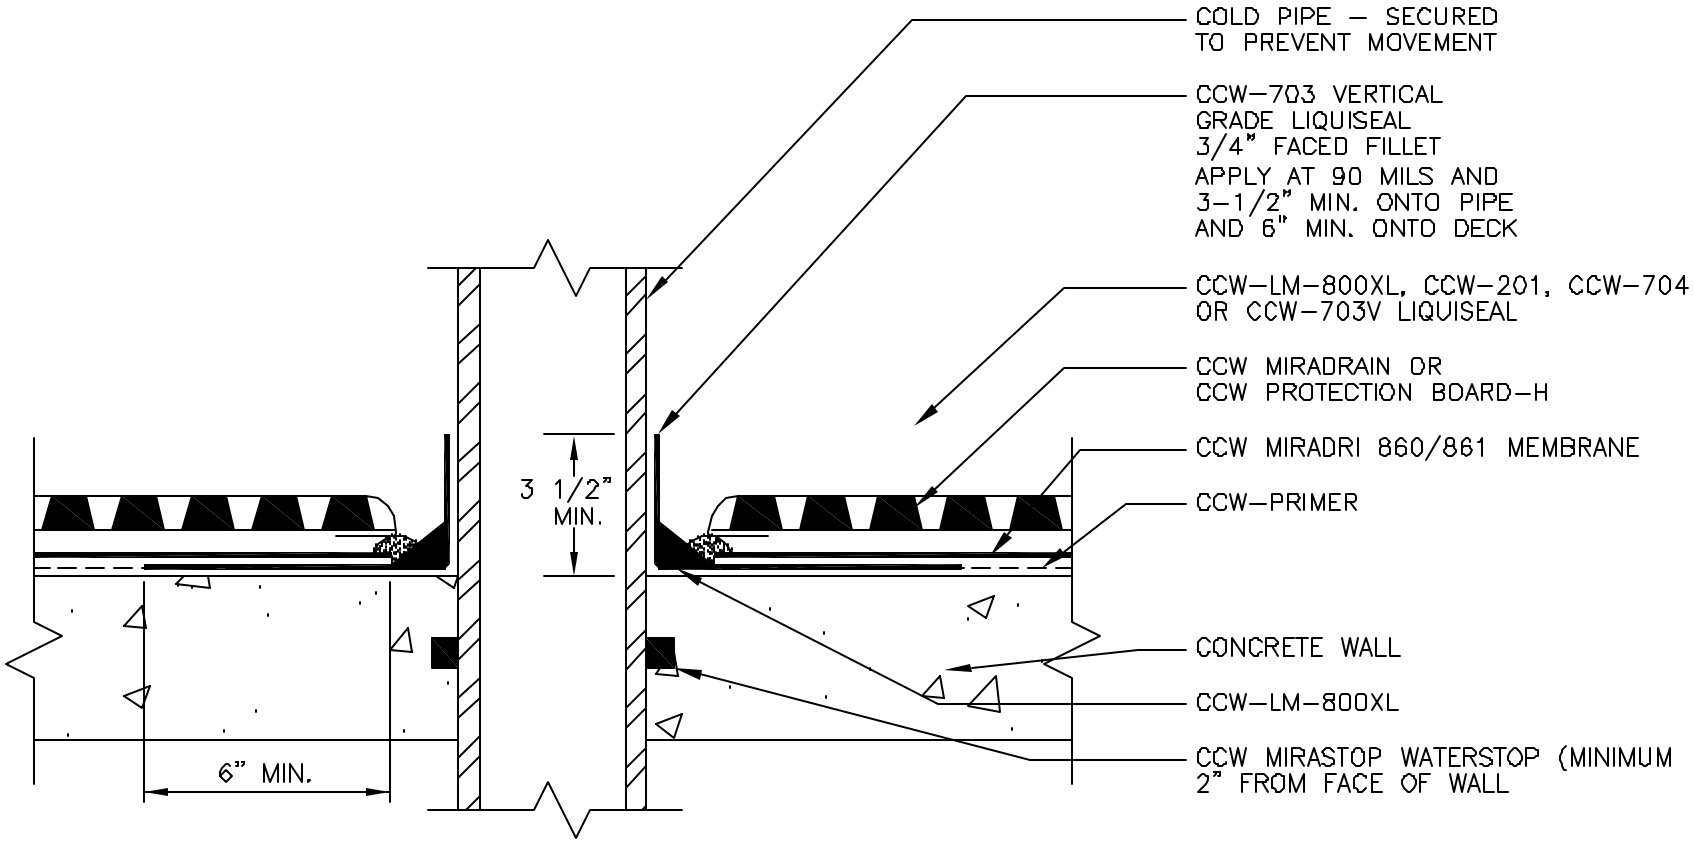

LIMITATION – ABRADE PVC PIPE PRIOR TO APPLYING CCW–703.

860–8A	PIPE / PENETRATIONS FLASHINGS	CARLISLE

© 2009 CARLISLE CORPORATION